

Pipes should not be fixed but should be positioned near connection, after the backfilling, connections must be performed after installation of the unit

Drainage pipe Ø110 PE
with hub and spigot joint
connection drainage system



Pipe Ø3/4" PE
water supply

Electric supply
230V F+N 3kW
Earthing

Drainage rain water Ø100

Drainage waste water
Ø50

Drainage clean water
Ø50

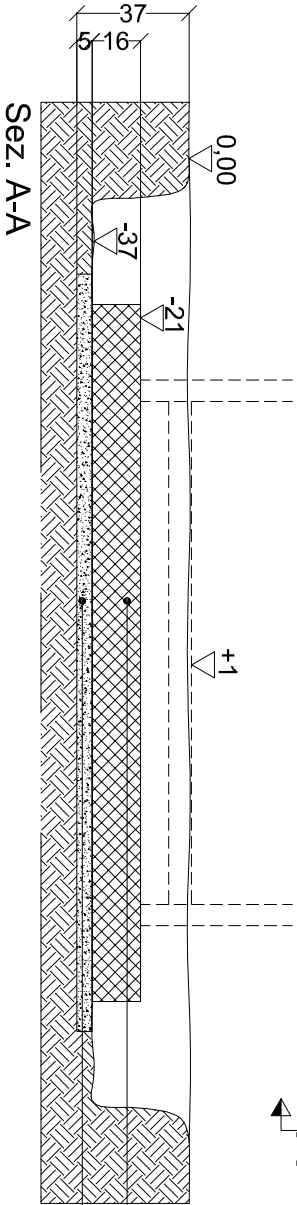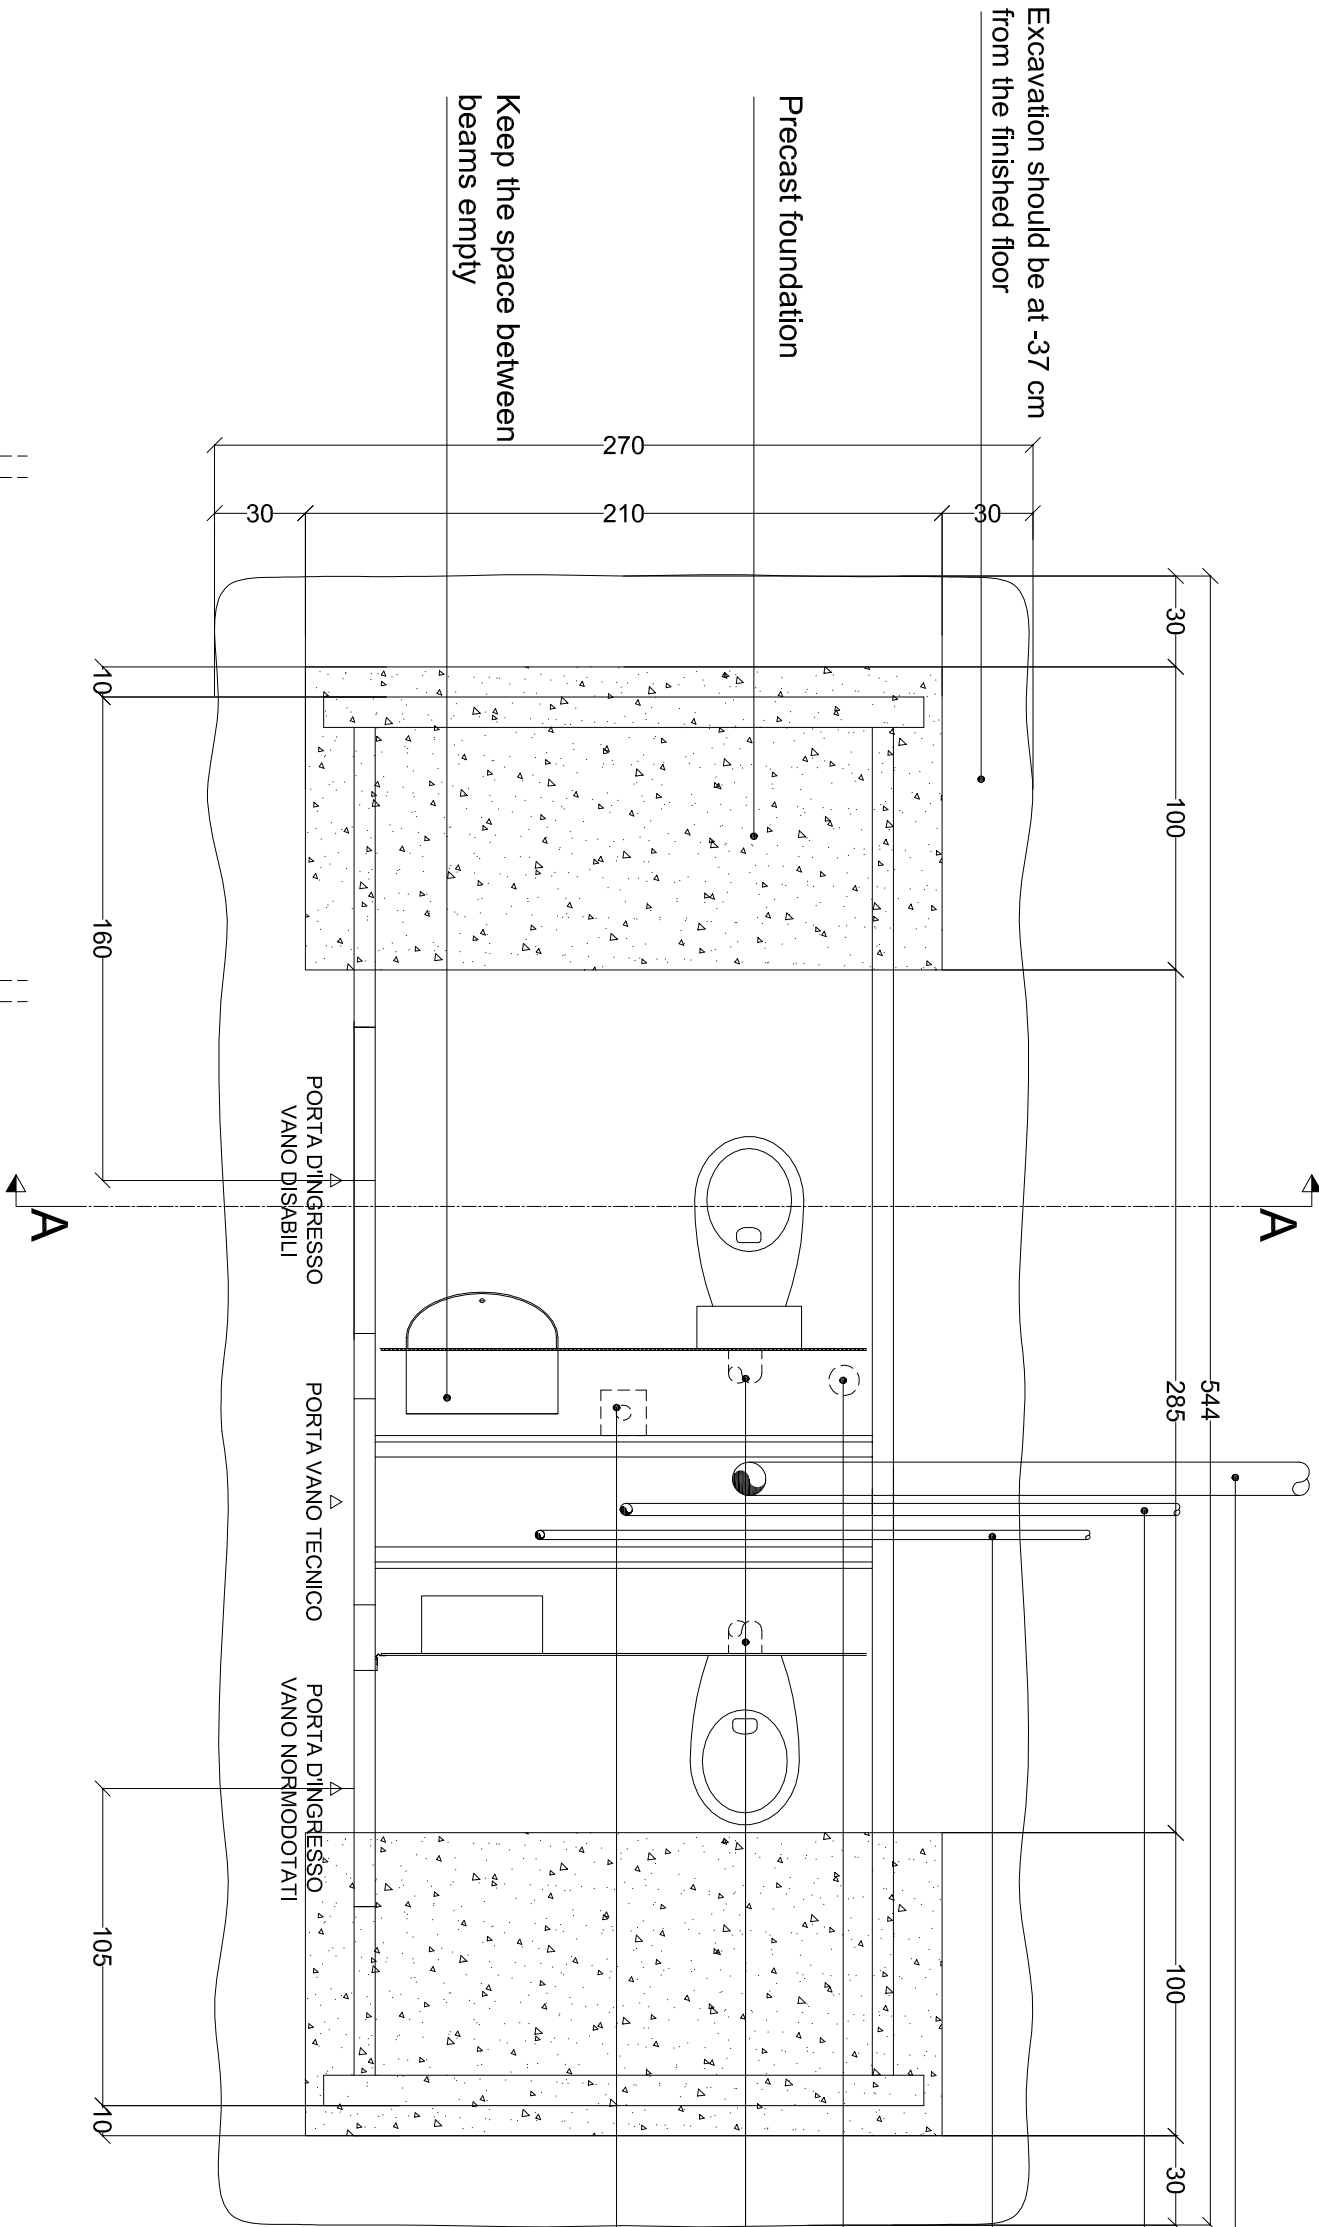

Keep the space between beams empty

N.B. Connections, backfill, and finishing must be done after APT laying

Rev. 0 Data 19/03/2015 Nota:

CODIFICA DISEGNO:

95151.R0-Fondazione-PREF.TCabHN

OGGETTO:

PRECAST FOUNDATION
T CAB HN

Materiale:

Note: PLANIMETRIA E SEZIONE



PTMATIC S.r.l.
Via Giotto, 1
20010 Bareggio (MI)
www.ptmatic.it

Tavola

Scala

1:25



Dis. da

L. Maestroni

Appr. da